


Sigma DocBox

Fire Alarm Document Box

Installation and Use

Man-1087 Issue 05 June 2013

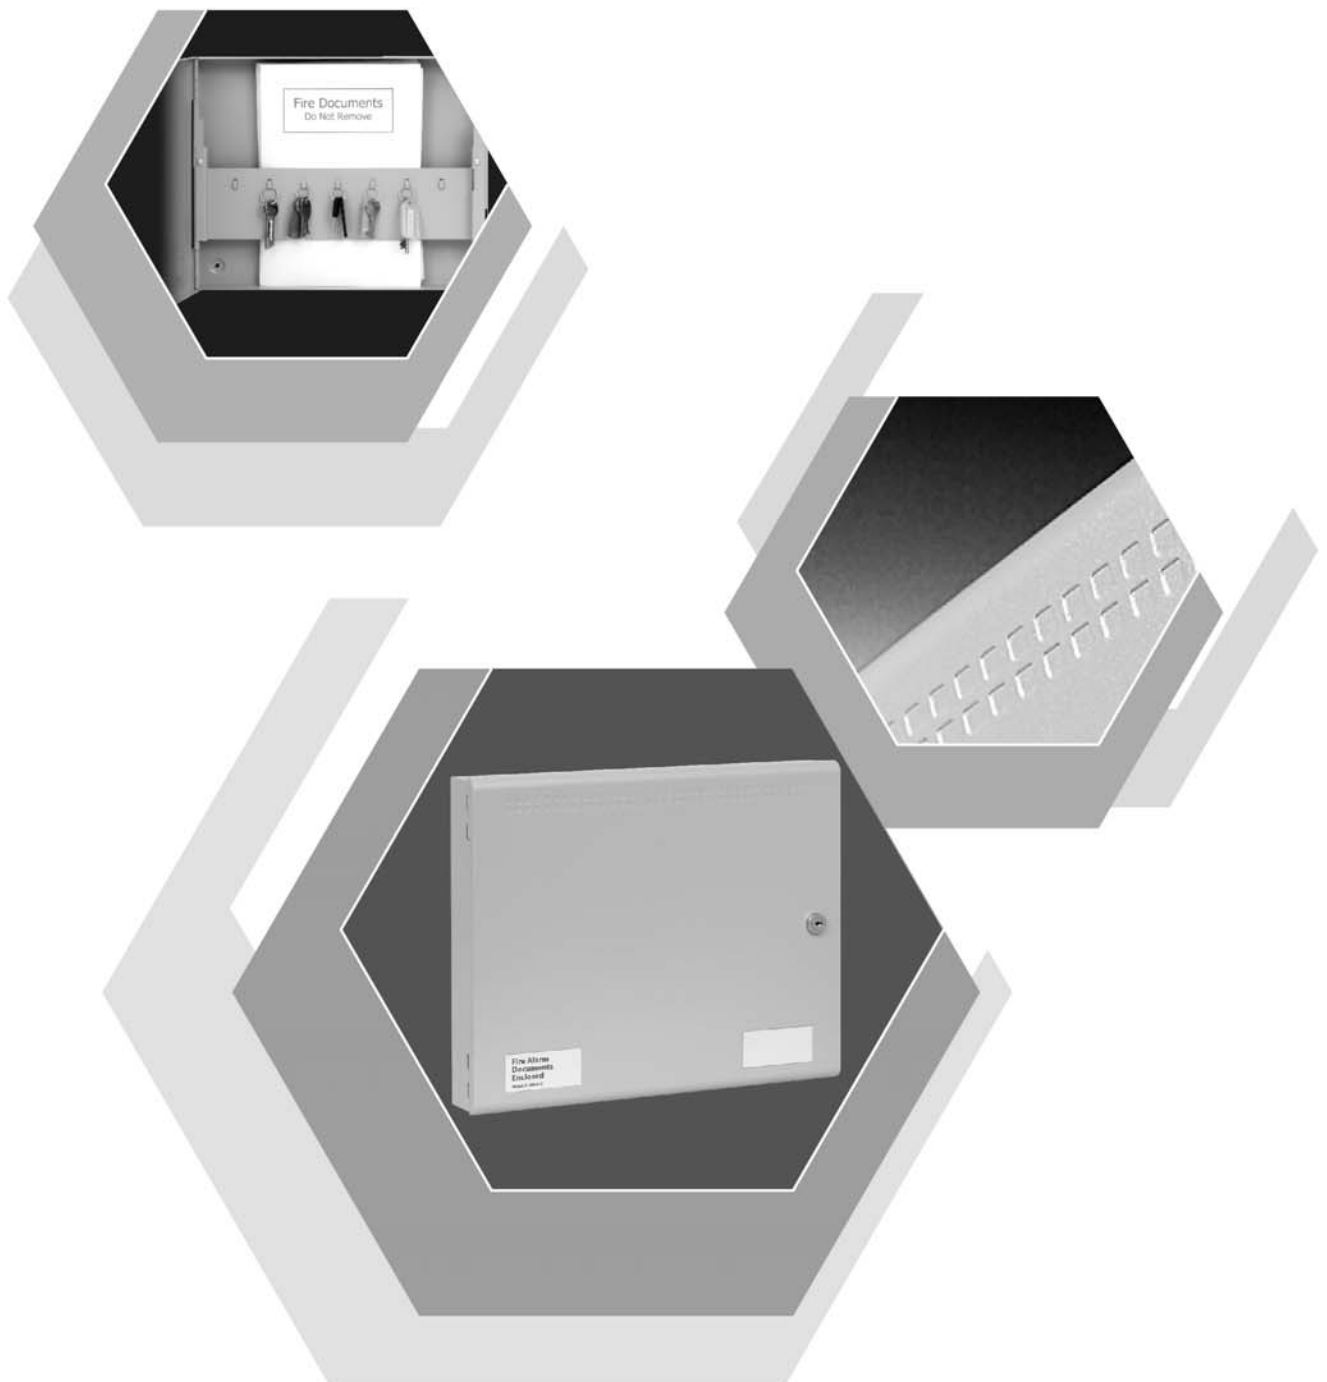

Installation

The document box is styled to match the Kentec Sigma range of fire alarm control equipment.

It should be mounted on a dry, flat surface, in a level position such that the enclosure is not distorted.

Screws or bolts of a minimum of 5mm diameter must be used to mount the enclosure in all three mounting positions.

It should be positioned in an accessible place as agreed with the end user.

Suitable fixings should be used at all fixing points such that the box is securely mounted and is not liable to move once fixed.



Once in place, all documents associated with the fire alarm or fire protection systems can be securely stored at a central point along with any keys associated with the systems for easy and reliable access.

The standard document box is 60mm deep (Part No. K16000L2). A 90 mm deep version (Part No. K16000M2) and a 110mm extra deep version (Part. No. K16000H2) is also available upon request

Two, standard keys are provided to lock the box and these should be stored by the person responsible for the fire alarm systems.

Spare key sets which fit all Kentec fire alarm equipment and accessories are available, part number S005.